

WATER

26 Attachment 1

Township of Plumstead

**APPENDIX A:
STORMWATER MANAGEMENT DESIGN
CRITERIA**

TABLE A-1

DESIGN STORM RAINFALL AMOUNT

Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html.

FIGURE A-1

ATLAS 14 TYPE II S-CURVES FOR ALL FREQUENCY STORMS – DOYLESTOWN GAGE (36-2221)

Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html.

TABLE A-2

NATURAL RESOURCE PROTECTION STORMWATER MANAGEMENT CONTROLS

Source: PA BMP Manual Chapter 8, pg 33

TABLE A-3

GUIDANCE TO CALCULATE THE 2-YEAR, 24-HOUR VOLUME INCREASE FROM PRE-DEVELOPMENT TO POST-DEVELOPMENT CONDITIONS

Source: PA BMP Manual Chapter 8, pg 37

TABLE A-4

RUNOFF CURVE NUMBERS

Source: NRCS (SCS) TR-55

TABLE A-5

VOLUME CONTROL CALCULATION GUIDANCE FOR NONSTRUCTURAL BMPS

Source: PA BMP Manual Chapter 8, pg 34

TABLE A-6

VOLUME CONTROL CALCULATION GUIDANCE FOR STRUCTURAL BMPS

Source: PA BMP Manual Chapter 8, pg 38

TABLE A-7

RATIONAL RUNOFF COEFFICIENTS

Source: New Jersey Department of Transportation, Technical Manual for Stream Encroachment, August, 1984

TABLE A-8

MANNING ROUGHNESS COEFFICIENTS

PLUMSTEAD CODE

**TABLE A-1
DESIGN STORM RAINFALL AMOUNT (INCHES)**

The design storm rainfall amount chosen for design should be obtained from the National Oceanic and Atmospheric Administration Atlas 14 interactive website:
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html

Source: NOAA Atlas 14 website, Doylestown Gage (36-2221)
http://hdsc.nws.noaa.gov/hdsc/pfds/orb/pa_pfds.html


Precipitation Frequency Estimates (inches)																		
ARI* (years)	5 min	10 min	15 min	30 min	6 min	120 min	3 hr	6 hr	12 hr	24 hr	48 hr	4 day	7 day	10 day	20 day	30 day	45 day	60 day
1	0.34	0.54	0.68	0.93	1.15	1.38	1.51	1.89	2.30	2.71	3.13	3.48	4.07	4.61	6.23	7.76	9.85	11.81
2	0.40	0.64	0.81	1.12	1.40	1.67	1.83	2.28	2.78	3.26	3.78	4.19	4.87	5.51	7.39	9.14	11.57	13.83
5	0.47	0.76	0.96	1.36	1.75	2.10	2.30	2.86	3.50	4.11	4.76	5.24	6.02	6.71	8.81	10.65	13.30	15.78
10	0.53	0.84	1.06	1.54	2.01	2.42	2.66	3.32	4.11	4.81	5.57	6.09	6.96	7.68	9.93	11.83	14.60	17.23
25	0.59	0.94	1.19	1.76	2.34	2.86	3.15	3.98	4.99	5.83	6.71	7.30	8.30	9.03	11.44	13.36	16.25	19.04
50	0.63	1.00	1.27	1.92	2.60	3.21	3.54	4.52	5.74	6.70	7.66	8.29	9.41	10.11	12.61	14.52	17.46	20.35
100	0.67	1.07	1.35	2.07	2.85	3.56	3.94	5.09	6.55	7.63	8.67	9.33	10.59	11.23	13.79	15.66	18.61	21.57
200	0.71	1.13	1.42	2.21	3.11	3.92	4.35	5.69	7.43	8.64	9.75	10.44	11.83	12.39	14.98	16.79	19.69	22.70
500	0.76	1.20	1.51	2.40	3.44	4.41	4.90	6.54	8.73	10.12	11.30	12.01	13.60	14.00	16.58	18.23	21.02	24.08
1000	0.79	1.24	1.56	2.53	3.69	4.78	5.34	7.23	9.82	11.35	12.57	13.29	15.04	15.28	17.80	19.31	21.96	25.04

* These precipitation frequency estimates are based on a partial duration series. ARI is the Average Recurrence Interval.

WATER

FIGURE A-1
Atlas 14 Type II S-Curves for All Frequency Storms – Doylestown Gage (36-2221)

Partial duration based Point Precipitation Frequency Estimates - Version: 3
 40.3 N 75.1333 W 305 ft

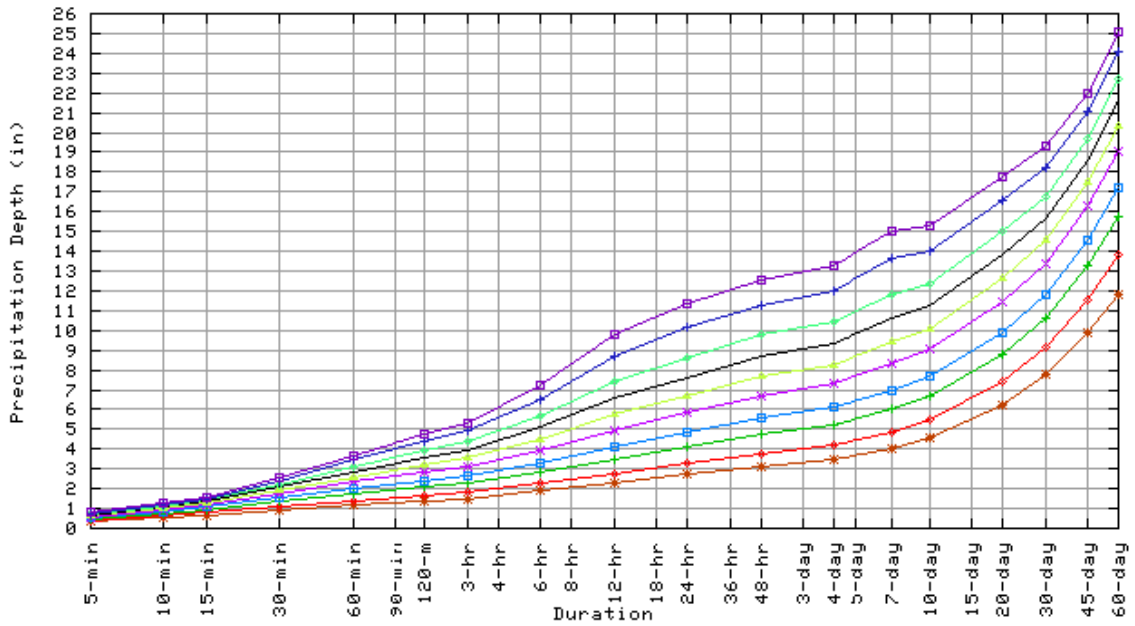

Wed Mar 11 12:14:10 2009

Average Recurrence Interval (years)	
1	*
2	+
5	+
10	+
25	+
50	+
100	+
200	+
500	+
1000	+

PLUMSTEAD CODE

**TABLE A-2: NATURAL RESOURCE PROTECTION
STORMWATER MANAGEMENT CONTROLS**

Existing Natural Sensitive Resource	Mapped in the ERSAM? Yes/No/n/a	Total Area (Ac.)	Area to be Protected (Ac.)
Waterbodies			
Floodplains			
Riparian Areas / Buffers			
Wetlands			
Vernal Pools			
Woodlands			
Natural Drainage Ways			
Steep Slopes, 15%-25%			
Steep Slopes, over 25%			
Other:			
Other:			
Total Existing:			

WATER

TABLE A-3: GUIDANCE TO CALCULATE THE 2-YEAR, 24-HOUR VOLUME INCREASE FROM PRE-DEVELOPMENT TO POST-DEVELOPMENT CONDITIONS

Existing Conditions: Cover Type/Condition	Soil Type	Area (sf)	Area (ac)	CN	S	Ia (0.2*S)	Q Runoff (in)	Runoff Volume (ft3)
Woodland								
Meadow								
Impervious								
Total:								

Developed Conditions: Cover Type/Condition	Soil Type	Area (sf)	Area (ac)	CN	S	Ia (0.2*S)	Q Runoff (in)	Runoff Volume (ft3)
Total:								

2-year Volume Increase (ft3):

PLUMSTEAD CODE

TABLE A-4. Runoff Curve Numbers (from NRCS (SCS) TR-55)

LAND USE DESCRIPTION	Hydrologic Condition	HYDROLOGIC SOIL GROUP			
		A	B	C	D
Open Space					
Grass cover < 50%	Poor	68	79	86	89
Grass cover 50% to 75%	Fair	49	69	79	84
Grass cover > 75%	Good	39	61	74	80
Meadow		30	58	71	78
Agricultural					
Pasture, grassland, or range – Continuous forage for grazing	Poor	68	79	86	89
Pasture, grassland, or range – Continuous forage for grazing.	Fair	49	69	79	84
Pasture, grassland, or range – Continuous forage for grazing	Good	39	61	74	80
Brush-weed-grass mixture with brush the major element.	Poor	48	67	77	83
Brush-weed-grass mixture with brush the major element.	Fair	35	56	70	77
Brush-weed-grass mixture with brush the major element.	Good	30	48	65	73
Fallow Bare soil	-----	77	86	91	94
Crop residue cover (CR)	Poor	76	85	90	93
	Good	74	83	88	90
Woods – grass combination (orchard or tree farm)	Poor	57	73	82	86
	Fair	43	65	76	82
	Good	32	58	72	79
Woods	Poor	45	66	77	83
	Fair	36	60	73	79
	Good	30	55	70	77
Commercial (85% Impervious)		89	92	94	95
Industrial (72% Impervious)		81	88	91	93
Institutional (50% Impervious)		71	82	88	90
Residential districts by average lot size:					
	% Impervious				
1/8 acre or less * (town houses)	65	77	85	90	92
1/4 acre	38	61	75	83	87
1/3 acre	30	57	72	81	86
1/2 acre	25	54	70	80	85
1 acre	20	51	68	79	84
2 acres	12	46	65	77	82
Farmstead		59	74	82	86
Smooth Surfaces (Concrete, Asphalt, Gravel or Bare Compacted Soil)		98	98	98	98
Water		98	98	98	98
Mining/Newly Graded Areas (Pervious Areas Only)		77	86	91	94

* Includes Multi-Family Housing unless justified lower density can be provided.

Note: Existing site conditions of bare earth or fallow ground shall be considered as meadow when choosing a CN value.

WATER

TABLE A-5: VOLUME CONTROL CALCULATION GUIDANCE FOR NONSTRUCTURAL BMPs

Type of Nonstructural BMP

$$\text{AREA (sq ft)} * \text{Runoff Volume (in)} * 1/12 = \text{Volume Reduction (ft}^3\text{)}$$

Use of Natural Drainage Feature

Utilize natural flow pathways _____ sq ft * 1/4" * 1/12 = _____ cu ft

Minimum Soil Compaction

Lawn _____ sq ft * 1/3" * 1/12 = _____ cu ft

Meadow _____ sq ft * 1/3" * 1/12 = _____ cu ft

Protecting existing trees (not located in protected area)

For trees within 20 feet of impervious cover:

Tree Canopy _____ sq ft * 1" * 1/12 = _____ cu ft

For trees within 20-100 feet of impervious cover:

Tree Canopy _____ sq ft * 1/2" * 1/12 = _____ cu ft

Rooftop Disconnection

For runoff directed to pervious and/or vegetative areas where infiltration occurs

Roof Area _____ sq ft * 1/4" * 1/12 = _____ cu ft

Impervious Disconnection

For runoff from impervious surfaces such as streets and concrete directed to pervious and/or vegetative areas where infiltration occurs

Impervious Area _____ sq ft * 1/4" * 1/12 = _____ cu ft

Total Volume Reduction _____ cu ft

* represents multiply

PLUMSTEAD CODE

TABLE A-6: VOLUME CONTROL CALCULATION GUIDANCE FOR STRUCTURAL BMPs

$$\text{Required Volume Control (ft}^3\text{)} - \text{Nonstructural Volume Control (ft}^3\text{)} = \text{Structural Volume Requirement (ft}^3\text{)}$$

Table B-3 Table B-5

Type	Proposed Structural BMP	Section in BMP Manual	Area (sq ft)	Storage Volume (cu ft)
Infiltration and / or Evapotranspiration	Porous Pavement	6.4.1		
	Infiltration Basin	6.4.2		
	Infiltration Bed	6.4.3		
	Infiltration Trench	6.4.4		
	Rain Garden/Bioretention	6.4.5		
	Dry Well/Seepage Pit	6.4.6		
	Constructed Filter	6.4.7		
	Vegetative Swale	6.4.8		
	Vegetative Filter Strip	6.4.9		
	Infiltration Berm	6.4.10		
Evaporation and / or Reuse	Vegetative Roof	6.5.1		
	Capture and Re-use	6.5.2		
Runoff Quality	Constructed Wetlands	6.6.1		
	Wet Pond / Retention Basin	6.6.2		
	Dry Extended Detention Basin	6.6.3		
	Water Quality Filters	6.6.4		
Restoration	Riparian Buffer Restoration	6.7.1		
	Landscape Restoration / Reforestation	6.7.2		
	Soil Amendment	6.7.3		
Other	Level Spreader	6.8.1		
	Special Storage Areas	6.8.2		
	other			

Total Volume Control from Structural BMPs: _____

WATER

TABLE A-7 RATIONAL RUNOFF COEFFICIENTS
By Hydrologic Soils Group and Overland Slope (%)

Land Use	A			B			C			D		
	0-2%	2-6%	6%+	0-2%	2-6%	6%+	0-2%	2-6%	6%+	0-2%	2-6%	6%+
Cultivated Land	0.08 _s	0.13	0.16	0.11	0.15	0.21	0.14	0.19	0.26	0.18	0.23	0.31
	0.14 _s	0.18	0.22	0.16	0.21	0.28	0.20	0.25	0.34	0.24	0.29	0.41
Pasture	0.12	0.20	0.30	0.18	0.28	0.37	0.24	0.34	0.44	0.30	0.40	0.50
	0.15	0.25	0.37	0.23	0.34	0.45	0.30	0.42	0.52	0.37	0.50	0.62
Meadow	0.10	0.16	0.25	0.14	0.22	0.30	0.20	0.28	0.36	0.24	0.30	0.40
	0.14	0.22	0.30	0.20	0.28	0.37	0.26	0.35	0.44	0.30	0.40	0.50
Forest	0.05	0.08	0.11	0.08	0.11	0.14	0.10	0.13	0.16	0.12	0.16	0.20
	0.08	0.11	0.14	0.10	0.14	0.18	0.12	0.16	0.20	0.15	0.20	0.25
Residential												
Lot Size 1/8 Acre	0.25	0.28	0.31	0.27	0.30	0.25	0.30	0.33	0.38	0.33	0.36	0.42
	0.33	0.37	0.40	0.35	0.39	0.44	0.38	0.42	0.49	0.41	0.45	0.54
Lot Size 1/4 Acre	0.22	0.26	0.29	0.24	0.29	0.33	0.27	0.31	0.36	0.30	0.34	0.40
	0.30	0.34	0.37	0.33	0.37	0.42	0.36	0.40	0.47	0.38	0.42	0.52
Lot Size 1/3 Acre	0.19	0.23	0.26	0.22	0.26	0.30	0.25	0.29	0.34	0.28	0.32	0.39
	0.28	0.32	0.35	0.30	0.35	0.39	0.33	0.38	0.45	0.36	0.40	0.50
Lot Size 1/2 Acre	0.16	0.20	0.24	0.19	0.23	0.28	0.22	0.27	0.32	0.26	0.30	0.37
	0.25	0.29	0.32	0.28	0.32	0.36	0.31	0.35	0.42	0.34	0.38	0.48
Lot Size 1 Acre	0.14	0.19	0.22	0.17	0.21	0.26	0.20	0.25	0.31	0.24	0.29	0.35
	0.22	0.26	0.29	0.24	0.28	0.34	0.28	0.32	0.40	0.31	0.35	0.46
Industrial	0.67	0.68	0.68	0.68	0.68	0.69	0.68	0.69	0.69	0.69	0.69	0.70
	0.85	0.85	0.86	0.85	0.86	0.86	0.86	0.86	0.87	0.86	0.86	0.88
Commercial	0.71	0.71	0.72	0.71	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72
	0.88	0.88	0.89	0.89	0.89	0.89	0.89	0.89	0.90	0.89	0.89	0.90
Streets	0.70	0.71	0.71	0.71	0.72	0.74	0.72	0.73	0.76	0.73	0.75	0.78
	0.76	0.77	0.79	0.80	0.82	0.84	0.84	0.85	0.89	0.89	0.91	0.95
Open Space	0.05	0.10	0.14	0.08	0.13	0.19	0.12	0.17	0.24	0.16	0.21	0.28
	0.11	0.16	0.20	0.14	0.19	0.26	0.18	0.23	0.32	0.22	0.27	0.39
Parking	0.85	0.86	0.87	0.85	0.86	0.87	0.85	0.86	0.87	0.85	0.86	0.87
	0.95	0.96	0.97	0.95	0.96	0.97	0.95	0.96	0.97	0.95	0.96	0.97

_s Runoff coefficients for storm recurrence intervals less than 25 years.

_s Runoff coefficients for storm recurrence intervals of 25 years or more.

Source: Rawls, W.J., S.L. Wong and R.H. McCuen, 1981, "Comparison of Urban Flood Frequency Procedures", Preliminary Draft, U.S. Department

PLUMSTEAD CODE

TABLE A-8. MANNING'S ROUGHNESS COEFFICIENTS

DESCRIPTION	Manning's n-value
Smooth-wall Plastic Pipe	0.011
Concrete Pipe	0.012
Smooth-lined Corrugated Metal Pipe	0.012
Corrugated Plastic Pipe	0.024
Annular Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 68 mm × 13 mm (2 2/3 in × 1/2 in) Corrugations 75 mm × 25 mm (3 in × 1 in) Corrugations 125 mm × 25 mm (5 in × 1 in) Corrugations 150 mm × 50 mm (6 in × 2 in) Corrugations	0.024 0.027 0.025 0.033
Helically Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 75 mm × 25 mm (3 in × 1 in), 125 mm × 25 mm (5 in × 1 in), or 150 mm × 50 mm (6 in × 2 in) Corrugations	0.024
Helically Corrugated Steel And Aluminum Alloy Pipe (Plain or polymer coated) 68 mm × 13 mm (2 2/3 in × 1/2 in) Corrugations a. Lower Coefficients* 450 mm (18 in) Diameter 600 mm (24 in) Diameter 900 mm (36 in) Diameter 1200 mm (48 in) Diameter 1500 mm (60 in) Diameter or larger b. Higher Coefficients**	0.014 0.016 0.019 0.020 0.021 0.024
Annular or Helically Corrugated Steel or Aluminum Alloy Pipe Arches or Other Non-Circular Metal Conduit (Plain or Polymer coated)	0.024
Vitrified Clay Pipe	0.012
Ductile Iron Pipe	0.013
Asphalt Pavement	0.015
Concrete Pavement	0.014
Grass Medians	0.050
Grass – Residential	0.30
Earth	0.020
Gravel	0.030
Rock	0.035
Cultivated Areas	0.030 - 0.050
Dense Brush	0.070 - 0.140
Heavy Timber (Little undergrowth)	0.100 - 0.150
Heavy Timber (w/underbrush)	0.40
Streams: a. Some Grass And Weeds (Little or no brush) b. Dense Growth of Weeds c. Some Weeds (Heavy brush on banks)	0.030 - 0.035 0.035 - 0.050 0.050 - 0.070

Notes:

* Use the lower coefficient if any one of the following conditions apply:

- a. A storm pipe longer than 20 diameters, which directly or indirectly connects to an inlet or manhole, located in swales adjacent to shoulders in cut areas or depressed medians.
- b. A storm pipe which is specially designed to perform under pressure.

**Use the higher coefficient if any one of the following conditions apply:

- a. A storm pipe which directly or indirectly connects to an inlet or manhole located in highway pavement sections or adjacent to curb or concrete median barrier.
- b. A storm pipe which is shorter than 20 diameters long.
- c. A storm pipe which is partly lined helically corrugated metal pipe.