

BILL NO. 17-16

ORDINANCE NO. 2274

AN ORDINANCE AMENDING SECTION 540.010, SUBSECTION (7) OF CHAPTER 500 OF THE MUNICIPAL CODE OF THE CITY OF WARRENTON, MISSOURI RELATING TO MINIMUM STANDARDS FOR STREET LIGHT CONSTRUCTION

BE IT ORDAINED BY THE BOARD OF ALDERMEN OF THE CITY OF WARRENTON, MISSOURI, AS FOLLOWS:

SECTION I. Chapter 540 of the Municipal Code, titled "MINIMUM STANDARD FOR STREET LIGHT CONSTRUCTION" is hereby amended by deleting subsection (7) and adding the following new subsection (7):

7. Breakaway fuses. Individual street lights shall be equipped with Cooper-Bussmann HEB-LW-RLA (breakaway) fuse holder with MOL10 fuse or an equivalent and the fuse be relocated in a NEMA weathertight enclosure and support bracket that has been pre-approved by the City. Box must be located 2'-5' from Power source and 10' clearance from transformer door. See Attached Exhibit A.

SECTION II. All ordinances or parts of ordinance in conflict with this Ordinance are hereby repealed.

SECTION III. This Ordinance shall take effect and be in full force from and after the passage and approval thereof.

READ TWO TIMES AND PASSED by the Board of Aldermen of the City of Warrenton, Missouri, this 7th day of June, 2016.


President of the Board of Aldermen

APPROVED BY THE MAYOR of the City of Warrenton, Missouri this 7th day of June, 2016.

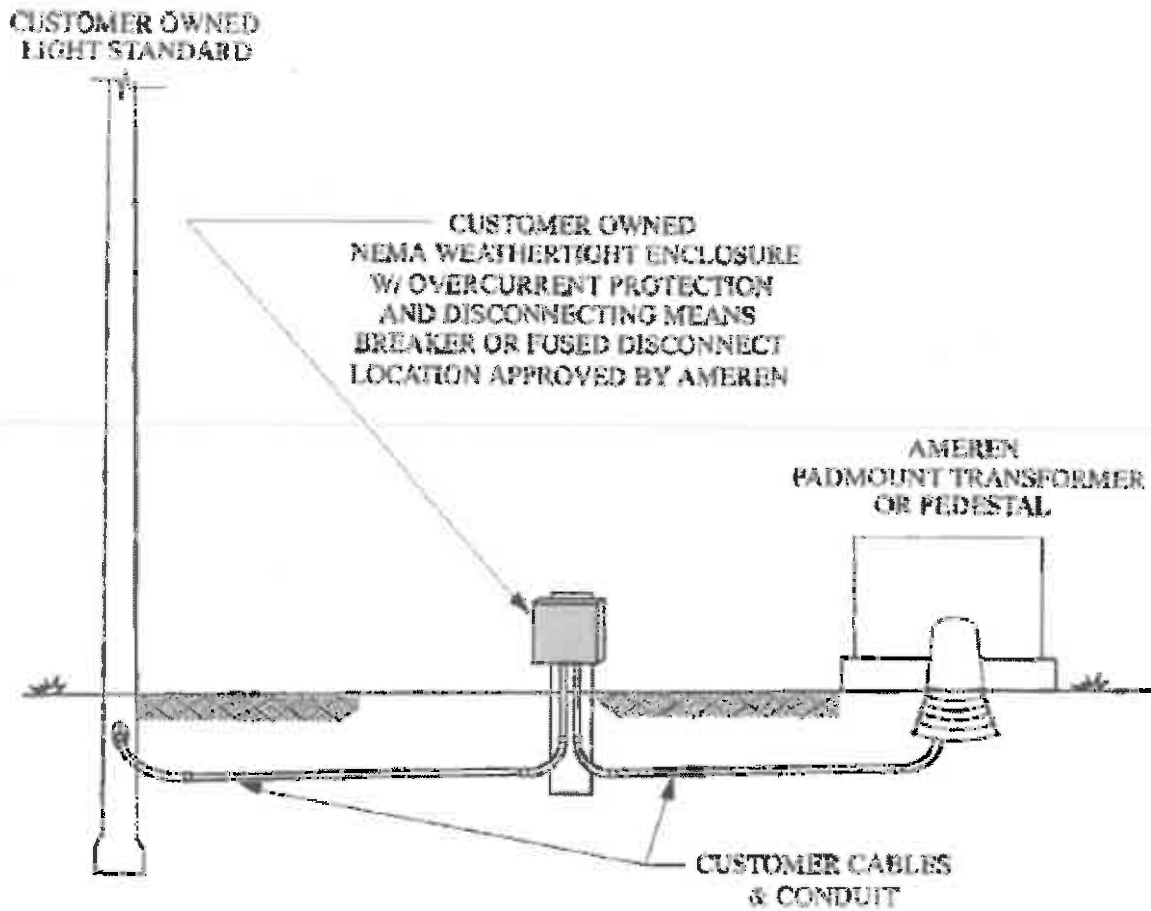

Mayor

ATTEST:


City Clerk

EXHIBIT A

**CUSTOMER OWNED LIGHTING (6M)
UNMETERED INSTALLATION**



**CUSTOMER TO INSTALL UG CABLE OR CONDUIT AND CABLE
INTO AMEREN TRANSFORMER OR FEDESTAL.
AMEREN TO CONNECT WITH PLUG FUSE.**